







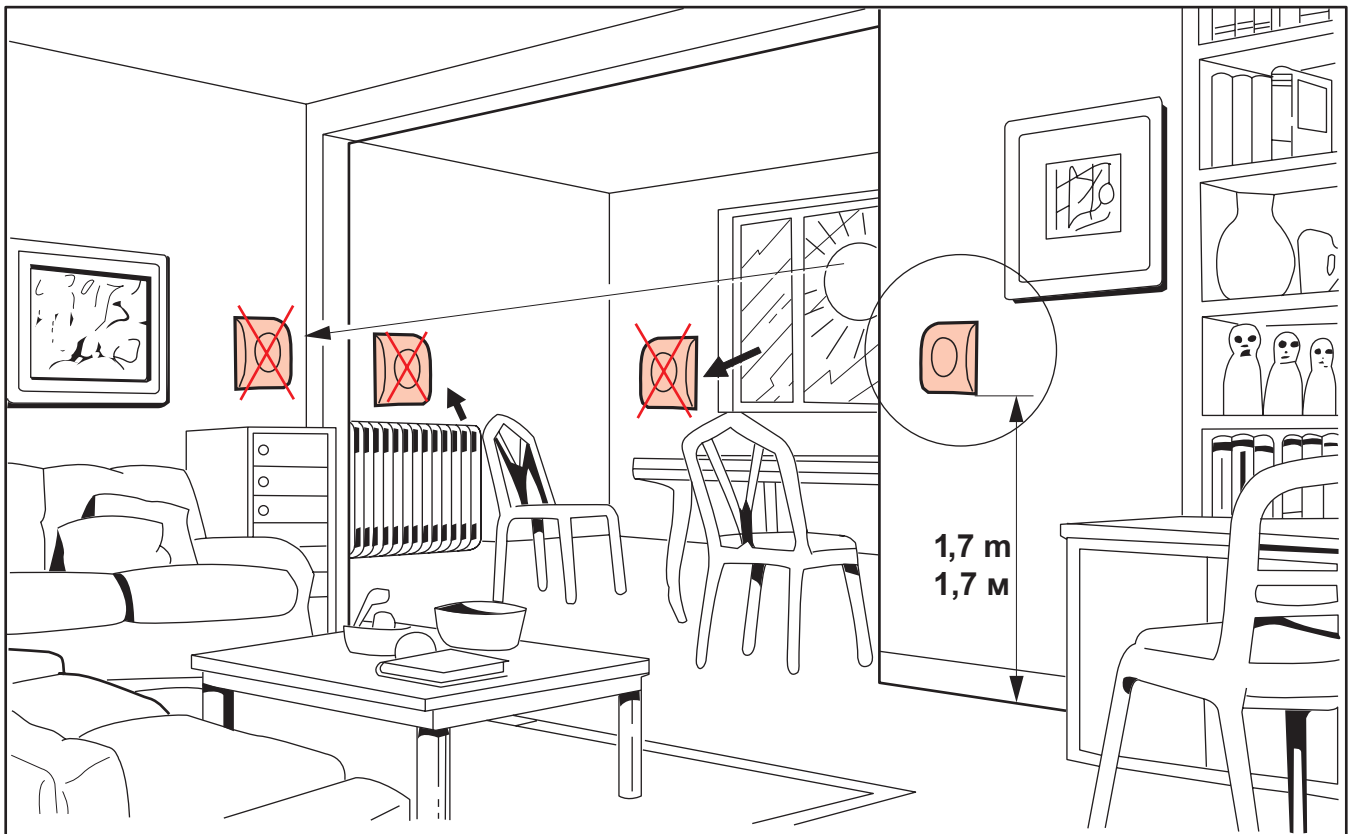


| | | | | |
|---|---|-----------------------|---|--|
|  |   | - 10°C ... +70°C |  | 8A max |
| |  | - 5°C ... +40°C | | 8A / 250V ~ $\mu \cos \varphi = 1$ 2A / 250V ~ $\mu \cos \varphi = 0,6$ |
| |   | (~ 7°C) ... +30°C | | 1mA ... 500mA 12...48V~ / 12...24V .. |
| |  | 2x 1,5mm ² | | P |

- Conforme à la norme NFC 47110 - Catégorie B ($\Delta 1$ K)
- Volgens de norm EN 60 730-1, 2-9
- Corresponds to rule EN 60 730-1, 2-9
- Entspricht der Norm EN 60 730-1, -2-9
- Corresponde a la norma EN 60730-1,-2-9

- EN 60 730-1, 2-9 standartına uygun.



• **Important :**

La régulation de température n'est effective que deux heures après la mise sous tension (période de stabilisation thermique de l'électronique).

- **Belanrijk :** De temperatuurregulatie is pas effectief 2 uur na het onder spanning plaatsen. (Thermische stabilisatieperiode van de electronica).

- **Important :** Temperature regulation is only effective two hours after the device has been switched on. (Thermal stabilisation period for the electronics).



- **Hinweis :** Die Temperaturregelung funktioniert erst 2h nach Inbetriebnahme richtig (Dauer der thermischen Stabilisierung).

- **Importante:** La regulación de la temperatura es únicamente efectiva 2 horas después de haber conectado el dispositivo (período de estabilización térmica del sistema electrónico).

- **Önemli:** Sıcaklık ayarlaması ancak cihaz açıldıktan iki saat sonra etkili olabilir. (Elektronik cihazların stabil duruma gelme periyodu).



- **Attention!** Pièces sous tension lorsque le enjoliveur est enlevé
- **Opgelet** bij afgenomen deksel: delen voeren spanning!
- **Caution!** Live parts when cover is removed.
- **Achtung!** Spannungsführende Teile bei entfernter Abdeckung
- **Atención:** Los componentes se encuentran bajo tensión, estando retirada la cubierta.
- **Dikkat!** Kapak çıkartıldığında elektrik çarpması tehlikesi.

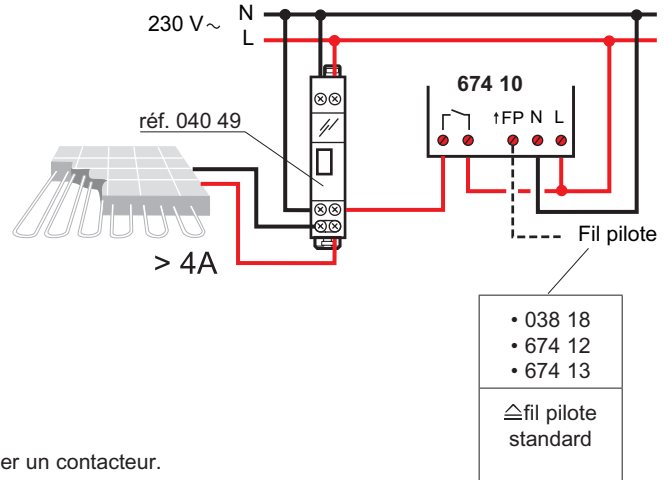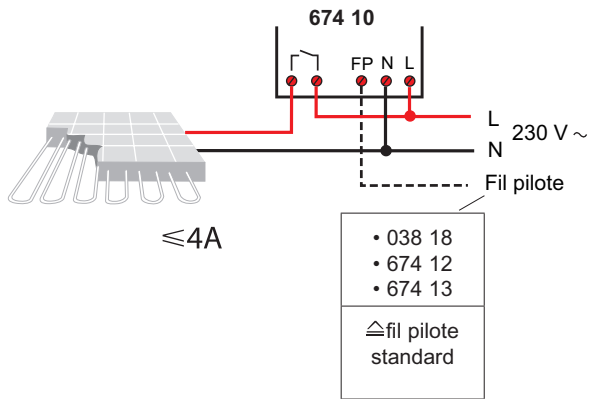

- Avec un courant de charge supérieur à 4 A, il est recommandé d'utiliser un contacteur.
- Bij laststroom groter dan 4A is het aangeraden een zekering te voorzien.
- It is advisable to use a contactor when operating with a load greater than 4A.
- Bei einem Laststrom grösser 4A, ist es empfehlenswert einen Schütz einzusetzen.
- Con una corriente de carga de más de 4A, se recomienda incorporar un contactor.
- 4 Amperden büyük yük kullanıldığında kontaktör kullanılması tavsiye edilir.

