



Ref. Certif. No.

FR_705078/A1

IEC SYSTEM FOR MUTUAL RECOGNITION OF TEST CERTIFICATES FOR ELECTRICAL EQUIPMENT (IECEE) CB SCHEME

CB TEST CERTIFICATE

Product

Residual current operated circuit-breakers without integral overcurrent protection for household and similar uses (RCCB's)

Name and address of the applicant

LEGRAND FRANCE
159 RUE JEAN JOANNON - ZI DES TROIS MOULINS
06606 ANTIBES - FRANCE

Name and address of the manufacturer

LEGRAND FRANCE
159 RUE JEAN JOANNON - ZI DES TROIS MOULINS
06606 ANTIBES - FRANCE

Name and address of the factory

See Annex

Note: When more than one factory, please report on page 2

Additional Information on page 2

Ratings and principal characteristics

See Annex

Trademark / Brand (if any)



Customer's Testing Facility (CTF) Stage used

CTF2

Model / Type Ref.

Series TX³, RX³, XC³, DX³
References : see annex

Additional information (if necessary may also be reported on page 2)

Supersedes CBTC FR_705078 dated 19/02/2019. Product evolution and addition of factories

Additional Information on page 2

A sample of the product was tested and found to be in conformity with

IEC 61008-1:2010(ed.3) +A1:2012 +A2:2013
IEC 61008-2-1:1990(ed.1)

As shown in the Test Report Ref. No. which forms part of this Certificate

13437609-775591-A,
13437609-775591-A1 to 13437609-775591-A7,
154382-718396, 154382-718396-1 to 154382-718396-39

This CB Test Certificate is issued by the National Certification Body



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
33 avenue du Général Leclerc
92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 10/10/2022



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES
S.A.S au capital de 15.745.984 €
RCS Nanterre B-498 363 174
33 avenue du Général Leclerc
F - 92266 FONTENAY AUX ROSES

Signature:
Julien GAUTHIER
Certification Officer

ANNEX

Name and address of the factories:**LEGRAND FRANCE**

290 AVENUE DE COLMAR
67100 STRASBOURG
FRANCE

LEGRAND FRANCE

159 RUE JEAN JOANNON
ZI DES TROIS MOULINS
06606 ANTIBES
FRANCE

LEGRAND ELEKTRIK SANAYI A.S

GOSB GEBZE ORGANIZE SANAYI BOLGESI
IHSAN DEDE CADDESI N°112
41480 GEBZE KOCAELI
TURKEY

M/S NOVATEUR ELECTRICAL AND DIGITAL SYSTEMS PRIVATE LIMITED

UNIT-II, BLOCK-A, B & D / UNIT-III, BLOCK C, Plot No-2, Sector-2, IIE, SIDCUL
249402 HARIDWAR, UTTARAKHAND
INDIA

NOVATEUR ELECTRICAL AND DIGITAL SYSTEMS PRIVATE LIMITED

D-4 MIDC INDUSTRIAL AREA, AJANTHA ROAD, JALGAON
425003 MAHARASHTRA
INDIA



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
33 avenue du Général Leclerc
92260 Fontenay-aux-Roses, FRANCE

www.lcie.fr

Date: 10/10/2022



LABORATOIRE CENTRAL DES
INDUSTRIES ELECTRIQUES
S.A.S au capital de 15.745.984 €
RCS Nanterre B 408 363 174
33 avenue du Général Leclerc
F - 92266 FONTENAY AUX ROSES

Signature: *Julien GAUTHIER*
Julien GAUTHIER
Certification Officer

ANNEX

REFERENCES, RATINGS AND MAIN CHARACTERISTICS

Reference TX ³ « Germanique » series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4117 07	25 A	400 V~	right	30 mA	AC	500 A	1000 A	10000 A	10000 A
4117 08	40 A	400 V~	right	30 mA	AC	500 A	1000 A	10000 A	10000 A
4117 09	63 A	400 V~	right	30 mA	AC	630 A	1000 A	10000 A	10000 A
4117 10	80 A	400 V~	right	30 mA	AC	800 A	1000 A	10000 A	10000 A
LG1293	100 A	400 V~	right	30 mA	AC	1000 A	1000 A	10000 A	10000 A
4117 17	25 A	400 V~	right	100 mA	AC	500 A	1000 A	10000 A	10000 A
4117 18	40 A	400 V~	right	100 mA	AC	500 A	1000 A	10000 A	10000 A
4117 19	63 A	400 V~	right	100 mA	AC	630 A	1000 A	10000 A	10000 A
4117 20	80 A	400 V~	right	100 mA	AC	800 A	1000 A	10000 A	10000 A
LG1294	100 A	400 V~	right	100 mA	AC	1000 A	1000 A	10000 A	10000 A
4117 27	25 A	400 V~	right	300 mA	AC	500 A	1000 A	10000 A	10000 A
4117 28	40 A	400 V~	right	300 mA	AC	500 A	1000 A	10000 A	10000 A
4117 29	63 A	400 V~	right	300 mA	AC	630 A	1000 A	10000 A	10000 A
4117 30	80 A	400 V~	right	300 mA	AC	800 A	1000 A	10000 A	10000 A
LG1295	100 A	400 V~	right	300 mA	AC	1000 A	1000 A	10000 A	10000 A
4117 37	25 A	400 V~	right	500 mA	AC	500 A	1000 A	10000 A	10000 A
4117 38	40 A	400 V~	right	500 mA	AC	500 A	1000 A	10000 A	10000 A
4117 39	63 A	400 V~	right	500 mA	AC	630 A	1000 A	10000 A	10000 A
4117 40	80 A	400 V~	right	500 mA	AC	800 A	1000 A	10000 A	10000 A
LG1296	100 A	400 V~	right	500 mA	AC	1000 A	1000 A	10000 A	10000 A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 10/10/2022



LABORATOIRE CENTRAL DES
 INDUSTRIES ELECTRIQUES
 S.A.S au capital de 15.745.984 €
 RCS Nanterre B 408 363 174
 33 avenue du Général Leclerc
 F - 92266 FONTENAY AUX ROSES


Signature:  Julie GAUTHIER
 Certification Officer

ANNEX (continued)

Reference TX ³ « Germanique » series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
411764 4119 31	25 A	400 V~	right	30 mA	A	500 A	1000 A	10000 A	10000 A
4117 65 4119 32	40 A	400 V~	right	30 mA	A	500 A	1000 A	10000 A	10000 A
4117 66 4119 33	63 A	400 V~	right	30 mA	A	630 A	1000 A	10000 A	10000 A
4117 67	80 A	400 V~	right	30 mA	A	800 A	1000 A	10000 A	10000 A
4117 68	100 A	400 V~	right	30 mA	A	1000 A	1000 A	10000 A	10000 A
411774 4119 36	25 A	400 V~	right	100 mA	A	500 A	1000 A	10000 A	10000 A
4117 75 4119 37	40 A	400 V~	right	100 mA	A	500 A	1000 A	10000 A	10000 A
4117 76 4119 38	63 A	400 V~	right	100 mA	A	630 A	1000 A	10000 A	10000 A
4117 77	80 A	400 V~	right	100 mA	A	800 A	1000 A	10000 A	10000 A
4117 78	100 A	400 V~	right	100 mA	A	1000 A	1000 A	10000 A	10000 A
4117 84	25 A	400 V~	right	300 mA	A	500 A	1000 A	10000 A	10000 A
4117 85 4119 42	40 A	400 V~	right	300 mA	A	500 A	1000 A	10000 A	10000 A
4117 86 4119 43	63 A	400 V~	right	300 mA	A	630 A	1000 A	10000 A	10000 A
4117 87	80 A	400 V~	right	300 mA	A	800 A	1000 A	10000 A	10000 A
4117 88	100 A	400 V~	right	300 mA	A	1000 A	1000 A	10000 A	10000 A
4117 94	25 A	400 V~	right	500 mA	A	500 A	1000 A	10000 A	10000 A
4117 95	40 A	400 V~	right	500 mA	A	500 A	1000 A	10000 A	10000 A
4117 96	63 A	400 V~	right	500 mA	A	630 A	1000 A	10000 A	10000 A
4117 97	80 A	400 V~	right	500 mA	A	800 A	1000 A	10000 A	10000 A
4117 98	100 A	400 V~	right	500 mA	A	1000 A	1000 A	10000 A	10000 A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
33 avenue du Général Leclerc
92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

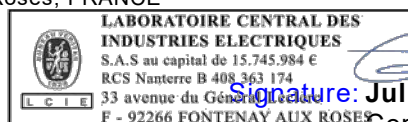

Signature: **Julien GAUTHIER**
Certification Officer

Date: 10/10/2022

ANNEX (continued)

Reference TX ³ « Germanique » series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
LG1309	25 A	400 V~	right	100 mA	AC-S	500 A	1000 A	10000 A	10000 A
4117 42	40 A	400 V~	right	100 mA	AC-S	500 A	1000 A	10000 A	10000 A
4117 43	63 A	400 V~	right	100 mA	AC-S	630 A	1000 A	10000 A	10000 A
LG1310	80 A	400 V~	right	100 mA	AC-S	800 A	1000 A	10000 A	10000 A
LG1311	100 A	400 V~	right	100 mA	AC-S	1000 A	1000 A	10000 A	10000 A

LG1312	25 A	400 V~	right	300 mA	AC-S	500 A	1000 A	10000 A	10000 A
4117 48	40 A	400 V~	right	300 mA	AC-S	500 A	1000 A	10000 A	10000 A
4117 49	63 A	400 V~	right	300 mA	AC-S	630 A	1000 A	10000 A	10000 A
LG1313	80 A	400 V~	right	300 mA	AC-S	800 A	1000 A	10000 A	10000 A
LG1314	100 A	400 V~	right	300 mA	AC-S	1000 A	1000 A	10000 A	10000 A

LG1315	25 A	400 V~	right	500 mA	AC-S	500 A	1000 A	10000 A	10000 A
LG1316	40 A	400 V~	right	500 mA	AC-S	500 A	1000 A	10000 A	10000 A
LG1317	63 A	400 V~	right	500 mA	AC-S	630 A	1000 A	10000 A	10000 A
LG1318	80 A	400 V~	right	500 mA	AC-S	800 A	1000 A	10000 A	10000 A
LG1319	100 A	400 V~	right	500 mA	AC-S	1000 A	1000 A	10000 A	10000 A


Reference TX ³ « Germanique » series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4119 51	25 A	400 V~	right	100 mA	A-S	500 A	1000 A	10000 A	10000 A
4119 52	40 A	400 V~	right	100 mA	A-S	500 A	1000 A	10000 A	10000 A
4119 53	63 A	400 V~	right	100 mA	A-S	630 A	1000 A	10000 A	10000 A
LG1304	80 A	400 V~	right	100 mA	A-S	800 A	1000 A	10000 A	10000 A
LG1305	100 A	400 V~	right	100 mA	A-S	1000 A	1000 A	10000 A	10000 A

4118 03	25 A	400 V~	right	300 mA	A-S	500 A	1000 A	10000 A	10000 A
4118 04	40 A	400 V~	right	300 mA	A-S	500 A	1000 A	10000 A	10000 A
4119 47	40 A	400 V~	right	300 mA	A-S	500 A	1000 A	10000 A	10000 A
4118 05	63 A	400 V~	right	300 mA	A-S	630 A	1000 A	10000 A	10000 A
4119 48	63 A	400 V~	right	300 mA	A-S	630 A	1000 A	10000 A	10000 A
4118 06	80 A	400 V~	right	300 mA	A-S	800 A	1000 A	10000 A	10000 A
LG1306	100 A	400 V~	right	300 mA	A-S	1000 A	1000 A	10000 A	10000 A

LG1307	25 A	400 V~	right	500 mA	A-S	500 A	1000 A	10000 A	10000 A
4118 07	40 A	400 V~	right	500 mA	A-S	500 A	1000 A	10000 A	10000 A
4118 08	63 A	400 V~	right	500 mA	A-S	630 A	1000 A	10000 A	10000 A
4118 09	80 A	400 V~	right	500 mA	A-S	800 A	1000 A	10000 A	10000 A
LG1308	100 A	400 V~	right	500 mA	A-S	1000 A	1000 A	10000 A	10000 A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

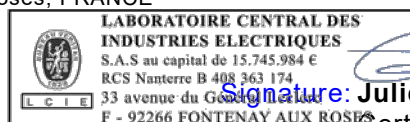

Signature: **Julien GAUTHIER**
 Certification Officer

Date: 10/10/2022

ANNEX (continued)


Reference TX ³ « Germanique » series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
LG1297	25 A	400 V~	right	30 mA	AC*	500 A	1000 A	10000 A	10000 A
4117 52	40 A	400 V~	right	30 mA	AC*	500 A	1000 A	10000 A	10000 A
4117 53	63 A	400 V~	right	30 mA	AC*	630 A	1000 A	10000 A	10000 A
LG1298	80 A	400 V~	right	30 mA	AC*	800 A	1000 A	10000 A	10000 A
LG2732	100 A	400 V~	right	30 mA	AC*	1000 A	1000 A	10000 A	10000 A
LG1299	25 A	400 V~	right	100 mA	AC*	500 A	1000 A	10000 A	10000 A
4117 56	40 A	400 V~	right	100 mA	AC*	500 A	1000 A	10000 A	10000 A
4117 57	63 A	400 V~	right	100 mA	AC*	630 A	1000 A	10000 A	10000 A
LG1300	80 A	400 V~	right	100 mA	AC*	800 A	1000 A	10000 A	10000 A
LG2734	100 A	400 V~	right	100 mA	AC*	1000 A	1000 A	10000 A	10000 A
LG2736	25 A	400 V~	right	300 mA	AC*	500 A	1000 A	10000 A	10000 A
LG2737	40 A	400 V~	right	300 mA	AC*	500 A	1000 A	10000 A	10000 A
LG2738	63 A	400 V~	right	300 mA	AC*	630 A	1000 A	10000 A	10000 A
LG2739	80 A	400 V~	right	300 mA	AC*	800 A	1000 A	10000 A	10000 A
LG2740	100 A	400 V~	right	300 mA	AC*	1000 A	1000 A	10000 A	10000 A

* RCCB's dedicated to Austria market



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 10/10/2022

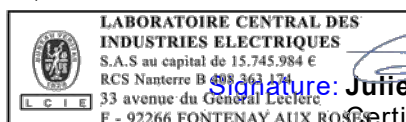

Signature: *Julien GAUTHIER*
Julien GAUTHIER
 Certification Officer


ANNEX (continued)

Reference TX ³ « Germanique » series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
LG7245	25 A	400 V~	left	30 mA	AC	500 A	1000 A	10000 A	10000 A
LG7246	40 A	400 V~	left	30 mA	AC	500 A	1000 A	10000 A	10000 A
LG7247	63 A	400 V~	left	30 mA	AC	630 A	1000 A	10000 A	10000 A
LG7248	80 A	400 V~	left	30 mA	AC	800 A	1000 A	10000 A	10000 A
LG7249	100 A	400 V~	left	30 mA	AC	1000 A	1000 A	10000 A	10000 A
LG7250	25 A	400 V~	left	100 mA	AC	500 A	1000 A	10000 A	10000 A
LG7251	40 A	400 V~	left	100 mA	AC	500 A	1000 A	10000 A	10000 A
LG7252	63 A	400 V~	left	100 mA	AC	630 A	1000 A	10000 A	10000 A
LG7253	80 A	400 V~	left	100 mA	AC	800 A	1000 A	10000 A	10000 A
LG7254	100 A	400 V~	left	100 mA	AC	1000 A	1000 A	10000 A	10000 A
LG7255	25 A	400 V~	left	300 mA	AC	500 A	1000 A	10000 A	10000 A
LG7256	40 A	400 V~	left	300 mA	AC	500 A	1000 A	10000 A	10000 A
LG7257	63 A	400 V~	left	300 mA	AC	630 A	1000 A	10000 A	10000 A
LG7258	80 A	400 V~	left	300 mA	AC	800 A	1000 A	10000 A	10000 A
LG7259	100 A	400 V~	left	300 mA	AC	1000 A	1000 A	10000 A	10000 A
LG7260	25 A	400 V~	left	500 mA	AC	500 A	1000 A	10000 A	10000 A
LG7261	40 A	400 V~	left	500 mA	AC	500 A	1000 A	10000 A	10000 A
LG7262	63 A	400 V~	left	500 mA	AC	630 A	1000 A	10000 A	10000 A
LG7263	80 A	400 V~	left	500 mA	AC	800 A	1000 A	10000 A	10000 A
LG7264	100 A	400 V~	left	500 mA	AC	1000 A	1000 A	10000 A	10000 A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 10/10/2022

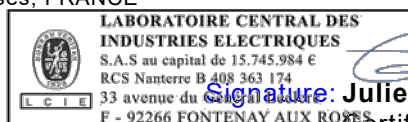
 Signature: **Julien GAUTHIER**
 Certification Officer


ANNEX (continued)

Reference TX ³ « Germanique » series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
LG2701	25 A	400 V~	left	30 mA	A	500 A	1000 A	10000 A	10000 A
LG2702	40 A	400 V~	left	30 mA	A	500 A	1000 A	10000 A	10000 A
LG2703	63 A	400 V~	left	30 mA	A	630 A	1000 A	10000 A	10000 A
LG2704	80 A	400 V~	left	30 mA	A	800 A	1000 A	10000 A	10000 A
LG2705	100 A	400 V~	left	30 mA	A	1000 A	1000 A	10000 A	10000 A
LG2707	25 A	400 V~	left	100 mA	A	500 A	1000 A	10000 A	10000 A
LG2708	40 A	400 V~	left	100 mA	A	500 A	1000 A	10000 A	10000 A
LG2709	63 A	400 V~	left	100 mA	A	630 A	1000 A	10000 A	10000 A
LG2710	80 A	400 V~	left	100 mA	A	800 A	1000 A	10000 A	10000 A
LG2711	100 A	400 V~	left	100 mA	A	1000 A	1000 A	10000 A	10000 A
LG2713	25 A	400 V~	left	300 mA	A	500 A	1000 A	10000 A	10000 A
LG2714	40 A	400 V~	left	300 mA	A	500 A	1000 A	10000 A	10000 A
LG2715	63 A	400 V~	left	300 mA	A	630 A	1000 A	10000 A	10000 A
LG2716	80 A	400 V~	left	300 mA	A	800 A	1000 A	10000 A	10000 A
LG2717	100 A	400 V~	left	300 mA	A	1000 A	1000 A	10000 A	10000 A
LG2719	25 A	400 V~	left	500 mA	A	500 A	1000 A	10000 A	10000 A
LG2720	40 A	400 V~	left	500 mA	A	500 A	1000 A	10000 A	10000 A
LG2721	63 A	400 V~	left	500 mA	A	630 A	1000 A	10000 A	10000 A
LG2722	80 A	400 V~	left	500 mA	A	800 A	1000 A	10000 A	10000 A
LG2723	100 A	400 V~	left	500 mA	A	1000 A	1000 A	10000 A	10000 A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 10/10/2022

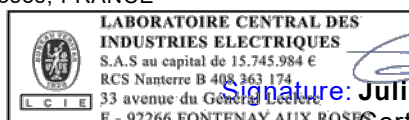

Signature: **Julien GAUTHIER**
 Certification Officer

ANNEX (continued)

Reference TX ³ « Germanique » series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
LG7265	25 A	400 V~	left	100 mA	AC-S	500 A	1000 A	10000 A	10000 A
LG7266	40 A	400 V~	left	100 mA	AC-S	500 A	1000 A	10000 A	10000 A
LG7267	63 A	400 V~	left	100 mA	AC-S	630 A	1000 A	10000 A	10000 A
LG7268	80 A	400 V~	left	100 mA	AC-S	800 A	1000 A	10000 A	10000 A
LG7269	100 A	400 V~	left	100 mA	AC-S	1000 A	1000 A	10000 A	10000 A
LG7270	25 A	400 V~	left	300 mA	AC-S	500 A	1000 A	10000 A	10000 A
LG7271	40 A	400 V~	left	300 mA	AC-S	500 A	1000 A	10000 A	10000 A
LG7272	63 A	400 V~	left	300 mA	AC-S	630 A	1000 A	10000 A	10000 A
LG7273	80 A	400 V~	left	300 mA	AC-S	800 A	1000 A	10000 A	10000 A
LG7274	100 A	400 V~	left	300 mA	AC-S	1000 A	1000 A	10000 A	10000 A
LG7275	25 A	400 V~	left	500 mA	AC-S	500 A	1000 A	10000 A	10000 A
LG7276	40 A	400 V~	left	500 mA	AC-S	500 A	1000 A	10000 A	10000 A
LG7277	63 A	400 V~	left	500 mA	AC-S	630 A	1000 A	10000 A	10000 A
LG7278	80 A	400 V~	left	500 mA	AC-S	800 A	1000 A	10000 A	10000 A
LG7279	100 A	400 V~	left	500 mA	AC-S	1000 A	1000 A	10000 A	10000 A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 10/10/2022


 Signature: Julien GAUTHIER
 Certification Officer

ANNEX (continued)

Reference TX ³ « Germanique » series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
LG7295	25 A	220/380 V~	left	30 mA	AC	500 A	1000 A	10000 A	10000 A
LG7296	40 A	220/380 V~	left	30 mA	AC	500 A	1000 A	10000 A	10000 A
LG7297	63 A	220/380 V~	left	30 mA	AC	630 A	1000 A	10000 A	10000 A
LG7298	80 A	220/380 V~	left	30 mA	AC	800 A	1000 A	10000 A	10000 A
LG7299	100 A	220/380 V~	left	30 mA	AC	1000 A	1000 A	10000 A	10000 A

LG7300	25 A	220/380 V~	left	300 mA	AC	500 A	1000 A	10000 A	10000 A
LG7301	40 A	220/380V~	left	300 mA	AC	500 A	1000 A	10000 A	10000 A
LG7302	63 A	220/380 V~	left	300 mA	AC	630 A	1000 A	10000 A	10000 A
LG7303	80 A	220/380 V~	left	300 mA	AC	800 A	1000 A	10000 A	10000 A
LG7304	100 A	220/380 V~	left	300 mA	AC	1000 A	1000 A	10000 A	10000 A

Reference TX ³ « Germanique » series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
LG7305	25 A	220/380 V~	left	30 mA	A	500 A	1000 A	10000 A	10000 A
LG7306	40 A	220/380 V~	left	30 mA	A	500 A	1000 A	10000 A	10000 A
LG7307	63 A	220/380 V~	left	30 mA	A	630 A	1000 A	10000 A	10000 A
LG7308	80 A	220/380 V~	left	30 mA	A	800 A	1000 A	10000 A	10000 A
LG7309	100 A	220/380 V~	left	30 mA	A	1000 A	1000 A	10000 A	10000 A

LG7310	25 A	220/380 V~	left	300 mA	A	500 A	1000 A	10000 A	10000 A
LG7311	40 A	220/380 V~	left	300 mA	A	500 A	1000 A	10000 A	10000 A
LG7312	63 A	220/380 V~	left	300 mA	A	630 A	1000 A	10000 A	10000 A
LG7313	80 A	220/380 V~	left	300 mA	A	800 A	1000 A	10000 A	10000 A
LG7314	100 A	220/380 V~	left	300 mA	A	1000 A	1000 A	10000 A	10000 A

These products are dedicated to brazilian and mexican market (voltage 220/380V).



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 10/10/2022



LABORATOIRE CENTRAL DES
 INDUSTRIES ELECTRIQUES
 S.A.S au capital de 15.745.984 €
 RCS Nanterre B 488.363.174
 33 avenue du Général Leclerc
 F - 92266 FONTENAY AUX ROSES

Signature: 
 Julien GAUTHIER
 Certification Officer

ANNEX (continued)

Reference TX ³ « Latin » series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4030 08 LG7426	25 A	400 V~	right	30 mA	AC	500 A	1000 A	10000 A	10000 A
4030 09 LG7427	40 A	400 V~	right	30 mA	AC	500 A	1000 A	10000 A	10000 A
4030 10 LG7428	63 A	400 V~	right	30 mA	AC	630 A	1000 A	10000 A	10000 A
LG1266 LG7429	80 A	400 V~	right	30 mA	AC	800 A	1000 A	10000 A	10000 A
LG1267 LG7430	100 A	400 V~	right	30 mA	AC	1000 A	1000 A	10000 A	10000 A
LG2621 LG7431	25 A	400 V~	right	100 mA	AC	500 A	1000 A	10000 A	10000 A
LG2622 LG7432	40 A	400 V~	right	100 mA	AC	500 A	1000 A	10000 A	10000 A
LG2623 LG7433	63 A	400 V~	right	100 mA	AC	630 A	1000 A	10000 A	10000 A
LG2624 LG7434	80 A	400 V~	right	100 mA	AC	800 A	1000 A	10000 A	10000 A
LG2625 LG7435	100 A	400 V~	right	100 mA	AC	1000 A	1000 A	10000 A	10000 A
4030 42 LG7436	25 A	400 V~	right	300 mA	AC	500 A	1000 A	10000 A	10000 A
4030 43 LG7437	40 A	400 V~	right	300 mA	AC	500 A	1000 A	10000 A	10000 A
4030 44 LG7438	63 A	400 V~	right	300 mA	AC	630 A	1000 A	10000 A	10000 A
LG2627 LG7439	80 A	400 V~	right	300 mA	AC	800 A	1000 A	10000 A	10000 A
LG2628 LG7440	100 A	400 V~	right	300 mA	AC	1000 A	1000 A	10000 A	10000 A
LG2630	25 A	400 V~	right	500 mA	AC	500 A	1000 A	10000 A	10000 A
LG2631	40 A	400 V~	right	500 mA	AC	500 A	1000 A	10000 A	10000 A
LG2632	63 A	400 V~	right	500 mA	AC	630 A	1000 A	10000 A	10000 A
LG2633	80 A	400 V~	right	500 mA	AC	800 A	1000 A	10000 A	10000 A
LG2634	100 A	400 V~	right	500 mA	AC	1000 A	1000 A	10000 A	10000 A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 10/10/2022



Signature: **Julien GAUTHIER**
 Certification Officer

ANNEX (continued)

Reference TX ³ « Latin » series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
LG1260 LG7441	25 A	400 V~	right	30 mA	A	500 A	1000 A	10000 A	10000 A
LG1261 LG7442	40 A	400 V~	right	30 mA	A	500 A	1000 A	10000 A	10000 A
LG1262 LG7443	63 A	400 V~	right	30 mA	A	630 A	1000 A	10000 A	10000 A
LG1263 LG7444	80 A	400 V~	right	30 mA	A	800 A	1000 A	10000 A	10000 A
LG1264 LG7445	100 A	400 V~	right	30 mA	A	1000 A	1000 A	10000 A	10000 A
LG2637 LG7446	25 A	400 V~	right	100 mA	A	500 A	1000 A	10000 A	10000 A
LG2638 LG7447	40 A	400 V~	right	100 mA	A	500 A	1000 A	10000 A	10000 A
LG2639 LG7448	63 A	400 V~	right	100 mA	A	630 A	1000 A	10000 A	10000 A
LG2640 LG7449	80 A	400 V~	right	100 mA	A	800 A	1000 A	10000 A	10000 A
LG2641 LG7450	100 A	400 V~	right	100 mA	A	1000 A	1000 A	10000 A	10000 A
LG2643 LG7451	25 A	400 V~	right	300 mA	A	500 A	1000 A	10000 A	10000 A
LG2644 LG7452	40 A	400 V~	right	300 mA	A	500 A	1000 A	10000 A	10000 A
LG2645 LG7453	63 A	400 V~	right	300 mA	A	630 A	1000 A	10000 A	10000 A
LG2646 LG7454	80 A	400 V~	right	300 mA	A	800 A	1000 A	10000 A	10000 A
LG2647 LG7455	100 A	400 V~	right	300 mA	A	1000 A	1000 A	10000 A	10000 A
LG2649	25 A	400 V~	right	500 mA	A	500 A	1000 A	10000 A	10000 A
LG2650	40 A	400 V~	right	500 mA	A	500 A	1000 A	10000 A	10000 A
LG2651	63 A	400 V~	right	500 mA	A	630 A	1000 A	10000 A	10000 A
LG2652	80 A	400 V~	right	500 mA	A	800 A	1000 A	10000 A	10000 A
LG2653	100 A	400 V~	right	500 mA	A	1000 A	1000 A	10000 A	10000 A




LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 10/10/2022



LABORATOIRE CENTRAL DES
 INDUSTRIES ELECTRIQUES
 S.A.S au capital de 15.745.984 €
 RCS Nanterre B 408 363 174
 33 avenue du Général Leclerc
 F - 92266 FONTENAY AUX ROSES

Signature:  **Julien GAUTHIER**
 Certification Officer


ANNEX (continued)

Reference TX ³ « Latin » series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4030 04	25 A	400 V~	left	30 mA	AC	500 A	1000 A	10000 A	10000 A
4030 05	40 A	400 V~	left	30 mA	AC	500 A	1000 A	10000 A	10000 A
4030 06	63 A	400 V~	left	30 mA	AC	630 A	1000 A	10000 A	10000 A
LG1268	80 A	400 V~	left	30 mA	AC	800 A	1000 A	10000 A	10000 A
LG1269	100 A	400 V~	left	30 mA	AC	1000 A	1000 A	10000 A	10000 A
LG2602	25 A	400 V~	left	100 mA	AC	500 A	1000 A	10000 A	10000 A
LG2603	40 A	400 V~	left	100 mA	AC	500 A	1000 A	10000 A	10000 A
LG2604	63 A	400 V~	left	100 mA	AC	630 A	1000 A	10000 A	10000 A
LG2605	80 A	400 V~	left	100 mA	AC	800 A	1000 A	10000 A	10000 A
LG2606	100 A	400 V~	left	100 mA	AC	1000 A	1000 A	10000 A	10000 A
LG2608	25 A	400 V~	left	300 mA	AC	500 A	1000 A	10000 A	10000 A
LG2609	40 A	400 V~	left	300 mA	AC	500 A	1000 A	10000 A	10000 A
LG2610	63 A	400 V~	left	300 mA	AC	630 A	1000 A	10000 A	10000 A
LG2611	80 A	400 V~	left	300 mA	AC	800 A	1000 A	10000 A	10000 A
LG2612	100 A	400 V~	left	300 mA	AC	1000 A	1000 A	10000 A	10000 A
LG2614	25 A	400 V~	left	500 mA	AC	500 A	1000 A	10000 A	10000 A
LG2615	40 A	400 V~	left	500 mA	AC	500 A	1000 A	10000 A	10000 A
LG2616	63 A	400 V~	left	500 mA	AC	630 A	1000 A	10000 A	10000 A
LG2617	80 A	400 V~	left	500 mA	AC	800 A	1000 A	10000 A	10000 A
LG2618	100 A	400 V~	left	500 mA	AC	1000 A	1000 A	10000 A	10000 A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 10/10/2022

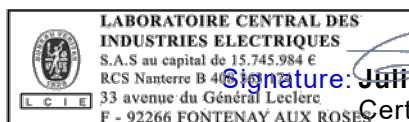

Signature: *Julien Gauthier*
Julien GAUTHIER
 Certification Officer

ANNEX (continued)

Reference XC ³ series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4031 90	25 A	400 V~	left	30 mA	AC	500 A	1000 A	10000 A	10000 A
4031 91	40 A	400 V~	left	30 mA	AC	500 A	1000 A	10000 A	10000 A
4031 92	63 A	400 V~	left	30 mA	AC	630 A	1000 A	10000 A	10000 A
4031 93	80 A	400 V~	left	30 mA	AC	800 A	1000 A	10000 A	10000 A

4031 94	25 A	400 V~	left	300 mA	AC	500 A	1000 A	10000 A	10000 A
4031 95	40 A	400 V~	left	300 mA	AC	500 A	1000 A	10000 A	10000 A
4031 96	63 A	400 V~	left	300 mA	AC	630 A	1000 A	10000 A	10000 A
4031 97	80 A	400 V~	left	300 mA	AC	800 A	1000 A	10000 A	10000 A

Reference XC ³ series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4032 32	25 A	400 V~	left	30 mA	A	500 A	1000 A	10000 A	10000 A
4032 33	40 A	400 V~	left	30 mA	A	500 A	1000 A	10000 A	10000 A
4032 34	63 A	400 V~	left	30 mA	A	630 A	1000 A	10000 A	10000 A
4032 35	80 A	400 V~	left	30 mA	A	800 A	1000 A	10000 A	10000 A

4032 36	25 A	400 V~	left	300 mA	A	500 A	1000 A	10000 A	10000 A
4032 37	40 A	400 V~	left	300 mA	A	500 A	1000 A	10000 A	10000 A
4032 38	63 A	400 V~	left	300 mA	A	630 A	1000 A	10000 A	10000 A
4032 39	80 A	400 V~	left	300 mA	A	800 A	1000 A	10000 A	10000 A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 10/10/2022



Signature: **Julien GAUTHIER**
 Certification Officer

ANNEX (continued)

Reference RX ³ series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4020 62	25 A	400 V~	right	30 mA	AC	500 A	1000 A	10000 A	10000 A
4020 63	40 A	400 V~	right	30 mA	AC	500 A	1000 A	10000 A	10000 A
4020 64	63 A	400 V~	right	30 mA	AC	630 A	1000 A	10000 A	10000 A
LG1282	80 A	400 V~	right	30 mA	AC	800 A	1000 A	10000 A	10000 A
LG1283	100 A	400 V~	right	30 mA	AC	1000 A	1000 A	10000 A	10000 A
4020 66	25 A	400 V~	right	100 mA	AC	500 A	1000 A	10000 A	10000 A
4020 67	40 A	400 V~	right	100 mA	AC	500 A	1000 A	10000 A	10000 A
4020 68	63 A	400 V~	right	100 mA	AC	630 A	1000 A	10000 A	10000 A
LG1284	80 A	400 V~	right	100 mA	AC	800 A	1000 A	10000 A	10000 A
LG1285	100 A	400 V~	right	100 mA	AC	1000 A	1000 A	10000 A	10000 A
4020 70	25 A	400 V~	right	300 mA	AC	500 A	1000 A	10000 A	10000 A
4020 71	40 A	400 V~	right	300 mA	AC	500 A	1000 A	10000 A	10000 A
4020 72	63 A	400 V~	right	300 mA	AC	630 A	1000 A	10000 A	10000 A
LG1286	80 A	400 V~	right	300 mA	AC	800 A	1000 A	10000 A	10000 A
LG1287	100 A	400 V~	right	300 mA	AC	1000 A	1000 A	10000 A	10000 A
LG2804	25 A	400 V~	right	500 mA	AC	500 A	1000 A	10000 A	10000 A
LG2805	40 A	400 V~	right	500 mA	AC	500 A	1000 A	10000 A	10000 A
LG2806	63 A	400 V~	right	500 mA	AC	630 A	1000 A	10000 A	10000 A
LG2807	80 A	400 V~	right	500 mA	AC	800 A	1000 A	10000 A	10000 A
LG2808	100 A	400 V~	right	500 mA	AC	1000 A	1000 A	10000 A	10000 A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 10/10/2022



LABORATOIRE CENTRAL DES
 INDUSTRIES ELECTRIQUES
 S.A.S au capital de 15.745.984 €
 RCS Nanterre B 408 063 174
 33 avenue du Général Leclerc
 F - 92266 FONTENAY AUX ROSES

Signature: *Julien Gauthier*
Julien GAUTHIER
 Certification Officer

ANNEX (continued)

Reference RX ³ series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4020 74	25 A	400 V~	right	30 mA	A	500 A	1000 A	10000 A	10000 A
4020 75 4025 39	40 A	400 V~	right	30 mA	A	500 A	1000 A	10000 A	10000 A
4020 76 4025 40	63 A	400 V~	right	30 mA	A	630 A	1000 A	10000 A	10000 A
LG1270	80 A	400 V~	right	30 mA	A	800 A	1000 A	10000 A	10000 A
LG1271	100 A	400 V~	right	30 mA	A	1000 A	1000 A	10000 A	10000 A
LG1272	25 A	400 V~	right	100 mA	A	500 A	1000 A	10000 A	10000 A
LG1273	40 A	400 V~	right	100 mA	A	500 A	1000 A	10000 A	10000 A
LG1274	63 A	400 V~	right	100 mA	A	630 A	1000 A	10000 A	10000 A
LG1275	80 A	400 V~	right	100 mA	A	800 A	1000 A	10000 A	10000 A
LG1276	100 A	400 V~	right	100 mA	A	1000 A	1000 A	10000 A	10000 A
LG1277	25 A	400 V~	right	300 mA	A	500 A	1000 A	10000 A	10000 A
LG1278 4025 41	40 A	400 V~	right	300 mA	A	500 A	1000 A	10000 A	10000 A
LG1279 4025 42	63 A	400 V~	right	300 mA	A	630 A	1000 A	10000 A	10000 A
LG1280	80 A	400 V~	right	300 mA	A	800 A	1000 A	10000 A	10000 A
LG1281	100 A	400 V~	right	300 mA	A	1000 A	1000 A	10000 A	10000 A
LG2814	25 A	400 V~	right	500 mA	A	500 A	1000 A	10000 A	10000 A
LG2815	40 A	400 V~	right	500 mA	A	500 A	1000 A	10000 A	10000 A
LG2816	63 A	400 V~	right	500 mA	A	630 A	1000 A	10000 A	10000 A
LG2817	80 A	400 V~	right	500 mA	A	800 A	1000 A	10000 A	10000 A
LG2818	100 A	400 V~	right	500 mA	A	1000 A	1000 A	10000 A	10000 A
Reference RX ³ series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4020 90	25 A	220/380 V~	left	30 mA	AC	500 A	1000 A	10000 A	10000 A
4020 91	40 A	220/380 V~	left	30 mA	AC	500 A	1000 A	10000 A	10000 A
4020 92	63 A	220/380 V~	left	30 mA	AC	630 A	1000 A	10000 A	10000 A
LG1288	80 A	220/380 V~	left	30 mA	AC	800 A	1000 A	10000 A	10000 A
LG1289	100 A	220/380 V~	left	30 mA	AC	1000 A	1000 A	10000 A	10000 A

These products are dedicated to Brazilian and Mexican market (voltage 220/380V).



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 10/10/2022



Signature: *Julien GAUTHIER*
 Certification Officer


ANNEX (continued)

Reference DX ³ series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4117 02	25 A	400 V~	right	30 mA	AC	500 A	1000 A	10000 A	10000 A
4117 03	40 A	400 V~	right	30 mA	AC	500 A	1000 A	10000 A	10000 A
4117 04	63 A	400 V~	right	30 mA	AC	630 A	1000 A	10000 A	10000 A
4117 05	80 A	400 V~	right	30 mA	AC	800 A	1000 A	10000 A	10000 A
LG992	100 A	400 V~	right	30 mA	AC	1000 A	1000 A	10000 A	10000 A
4117 12	25 A	400 V~	right	100 mA	AC	500 A	1000 A	10000 A	10000 A
4117 13	40 A	400 V~	right	100 mA	AC	500 A	1000 A	10000 A	10000 A
4117 14	63 A	400 V~	right	100 mA	AC	630 A	1000 A	10000 A	10000 A
4117 15	80 A	400 V~	right	100 mA	AC	800 A	1000 A	10000 A	10000 A
LG993	100 A	400 V~	right	100 mA	AC	1000 A	1000 A	10000 A	10000 A
4117 22	25 A	400 V~	right	300 mA	AC	500 A	1000 A	10000 A	10000 A
4117 23	40 A	400 V~	right	300 mA	AC	500 A	1000 A	10000 A	10000 A
4117 24	63 A	400 V~	right	300 mA	AC	630 A	1000 A	10000 A	10000 A
4117 25	80 A	400 V~	right	300 mA	AC	800 A	1000 A	10000 A	10000 A
LG994	100 A	400 V~	right	300 mA	AC	1000 A	1000 A	10000 A	10000 A
4117 32	25 A	400 V~	right	500 mA	AC	500 A	1000 A	10000 A	10000 A
4117 33	40 A	400 V~	right	500 mA	AC	500 A	1000 A	10000 A	10000 A
4117 34	63 A	400 V~	right	500 mA	AC	630 A	1000 A	10000 A	10000 A
4117 35	80 A	400 V~	right	500 mA	AC	800 A	1000 A	10000 A	10000 A
LG995	100 A	400 V~	right	500 mA	AC	1000 A	1000 A	10000 A	10000 A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 10/10/2022



Signature: *Julien GAUTHIER*
 Certification Officer


ANNEX (continued)

Reference DX ³ series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4117 59	25 A	400 V~	right	30 mA	A	500 A	1000 A	10000 A	10000 A
4117 60	40 A	400 V~	right	30 mA	A	500 A	1000 A	10000 A	10000 A
4117 61	63 A	400 V~	right	30 mA	A	630 A	1000 A	10000 A	10000 A
4117 62	80 A	400 V~	right	30 mA	A	800 A	1000 A	10000 A	10000 A
4117 63	100 A	400 V~	right	30 mA	A	1000 A	1000 A	10000 A	10000 A
4117 69	25 A	400 V~	right	100 mA	A	500 A	1000 A	10000 A	10000 A
4117 70	40 A	400 V~	right	100 mA	A	500 A	1000 A	10000 A	10000 A
4117 71	63 A	400 V~	right	100 mA	A	630 A	1000 A	10000 A	10000 A
4117 72	80 A	400 V~	right	100 mA	A	800 A	1000 A	10000 A	10000 A
4117 73	100 A	400 V~	right	100 mA	A	1000 A	1000 A	10000 A	10000 A
4117 79	25 A	400 V~	right	300 mA	A	500 A	1000 A	10000 A	10000 A
4117 80	40 A	400 V~	right	300 mA	A	500 A	1000 A	10000 A	10000 A
4117 81	63 A	400 V~	right	300 mA	A	630 A	1000 A	10000 A	10000 A
4117 82	80 A	400 V~	right	300 mA	A	800 A	1000 A	10000 A	10000 A
4117 83	100 A	400 V~	right	300 mA	A	1000 A	1000 A	10000 A	10000 A
4117 89	25 A	400 V~	right	500 mA	A	500 A	1000 A	10000 A	10000 A
4117 90	40 A	400 V~	right	500 mA	A	500 A	1000 A	10000 A	10000 A
4117 91	63 A	400 V~	right	500 mA	A	630 A	1000 A	10000 A	10000 A
4117 92	80 A	400 V~	right	500 mA	A	800 A	1000 A	10000 A	10000 A
4117 93	100 A	400 V~	right	500 mA	A	1000 A	1000 A	10000 A	10000 A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 10/10/2022

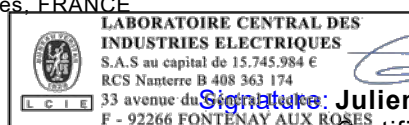

Signature: **Julien GAUTHIER**
 Certification Officer


ANNEX (continued)

Reference DX ³ series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
LG1118	25 A	400 V~	right	100 mA	AC-S	500 A	1000 A	10000 A	10000 A
LG996	40 A	400 V~	right	100 mA	AC-S	500 A	1000 A	10000 A	10000 A
LG997	63 A	400 V~	right	100 mA	AC-S	630 A	1000 A	10000 A	10000 A
LG1119	80 A	400 V~	right	100 mA	AC-S	800 A	1000 A	10000 A	10000 A
LG1120	100 A	400 V~	right	100 mA	AC-S	1000 A	1000 A	10000 A	10000 A
LG1121	25 A	400 V~	right	300 mA	AC-S	500 A	1000 A	10000 A	10000 A
4117 45	40 A	400 V~	right	300 mA	AC-S	500 A	1000 A	10000 A	10000 A
4117 46	63 A	400 V~	right	300 mA	AC-S	630 A	1000 A	10000 A	10000 A
LG1122	80 A	400 V~	right	300 mA	AC-S	800 A	1000 A	10000 A	10000 A
LG1123	100 A	400 V~	right	300 mA	AC-S	1000 A	1000 A	10000 A	10000 A
LG1124	25 A	400 V~	right	500 mA	AC-S	500 A	1000 A	10000 A	10000 A
LG1125	40 A	400 V~	right	500 mA	AC-S	500 A	1000 A	10000 A	10000 A
LG1126	63 A	400 V~	right	500 mA	AC-S	630 A	1000 A	10000 A	10000 A
LG1127	80 A	400 V~	right	500 mA	AC-S	800 A	1000 A	10000 A	10000 A
LG1128	100 A	400 V~	right	500 mA	AC-S	1000 A	1000 A	10000 A	10000 A
Reference DX ³ series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
LG1031	25 A	400 V~	right	100 mA	A-S	500 A	1000 A	10000 A	10000 A
LG1032	40 A	400 V~	right	100 mA	A-S	500 A	1000 A	10000 A	10000 A
LG1033	63 A	400 V~	right	100 mA	A-S	630 A	1000 A	10000 A	10000 A
LG1034	80 A	400 V~	right	100 mA	A-S	800 A	1000 A	10000 A	10000 A
LG1035	100 A	400 V~	right	100 mA	A-S	1000 A	1000 A	10000 A	10000 A
LG998	25 A	400 V~	right	300 mA	A-S	500 A	1000 A	10000 A	10000 A
4118 00	40 A	400 V~	right	300 mA	A-S	500 A	1000 A	10000 A	10000 A
4118 01	63 A	400 V~	right	300 mA	A-S	630 A	1000 A	10000 A	10000 A
LG999	80 A	400 V~	right	300 mA	A-S	800 A	1000 A	10000 A	10000 A
LG1000	100 A	400 V~	right	300 mA	A-S	1000 A	1000 A	10000 A	10000 A
LG1001	25 A	400 V~	right	500 mA	A-S	500 A	1000 A	10000 A	10000 A
LG1002	40 A	400 V~	right	500 mA	A-S	500 A	1000 A	10000 A	10000 A
LG1003	63 A	400 V~	right	500 mA	A-S	630 A	1000 A	10000 A	10000 A
LG1004	80 A	400 V~	right	500 mA	A-S	800 A	1000 A	10000 A	10000 A
LG1005	100 A	400 V~	right	500 mA	A-S	1000 A	1000 A	10000 A	10000 A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 10/10/2022

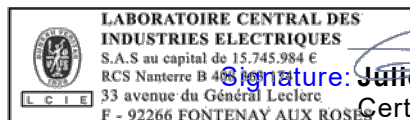

Signature: *Julien GAUTHIER*
 Certification Officer

ANNEX (continued)


Reference DX ³ series	I _n	U _n	Neutral position	I Δ n	Type	I _m	I Δ m	I _{nc}	I Δ c
LG3181	25 A	400 V~	right	30 mA	AC*	500 A	1000 A	10000 A	10000 A
LG3182	40 A	400 V~	right	30 mA	AC*	500 A	1000 A	10000 A	10000 A
LG3183	63 A	400 V~	right	30 mA	AC*	630 A	1000 A	10000 A	10000 A
LG3184	80 A	400 V~	right	30 mA	AC*	800 A	1000 A	10000 A	10000 A
LG3185	100 A	400 V~	right	30 mA	AC*	1000 A	1000 A	10000 A	10000 A
LG3187	25 A	400 V~	right	100 mA	AC*	500 A	1000 A	10000 A	10000 A
LG3188	40 A	400 V~	right	100 mA	AC*	500 A	1000 A	10000 A	10000 A
LG3189	63 A	400 V~	right	100 mA	AC*	630 A	1000 A	10000 A	10000 A
LG3190	80 A	400 V~	right	100 mA	AC*	800 A	1000 A	10000 A	10000 A
LG3191	100 A	400 V~	right	100 mA	AC*	1000 A	1000 A	10000 A	10000 A
LG3193	25 A	400 V~	right	300 mA	AC*	500 A	1000 A	10000 A	10000 A
LG3194	40 A	400 V~	right	300 mA	AC*	500 A	1000 A	10000 A	10000 A
LG3195	63 A	400 V~	right	300 mA	AC*	630 A	1000 A	10000 A	10000 A
LG3196	80 A	400 V~	right	300 mA	AC*	800 A	1000 A	10000 A	10000 A
LG3197	100 A	400 V~	right	300 mA	AC*	1000 A	1000 A	10000 A	10000 A

* RCCB's dedicated to Austria market



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 10/10/2022

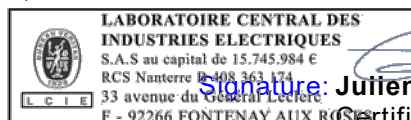

Signature: **Julien GAUTHIER**
 Certification Officer

ANNEX (continued)

Reference DX ³ series	In	Un	Neutral position	IΔn	Type	I _m	IΔm	I _{nc}	IΔc
4116 60	25 A	400 V~	left	30 mA	AC	500 A	1000 A	10000 A	10000 A
4116 61	40 A	400 V~	left	30 mA	AC	500 A	1000 A	10000 A	10000 A
4116 62	63 A	400 V~	left	30 mA	AC	630 A	1000 A	10000 A	10000 A
4116 63	80 A	400 V~	left	30 mA	AC	800 A	1000 A	10000 A	10000 A
LG1021	100 A	400 V~	left	30 mA	AC	1000 A	1000 A	10000 A	10000 A
LG3102	25 A	400 V~	left	100 mA	AC	500 A	1000 A	10000 A	10000 A
LG3103	40 A	400 V~	left	100 mA	AC	500 A	1000 A	10000 A	10000 A
LG3104	63 A	400 V~	left	100 mA	AC	630 A	1000 A	10000 A	10000 A
LG3105	80 A	400 V~	left	100 mA	AC	800 A	1000 A	10000 A	10000 A
LG3106	100 A	400 V~	left	100 mA	AC	1000 A	1000 A	10000 A	10000 A
4116 64	25 A	400 V~	left	300 mA	AC	500 A	1000 A	10000 A	10000 A
4116 65	40 A	400 V~	left	300 mA	AC	500 A	1000 A	10000 A	10000 A
4116 66	63 A	400 V~	left	300 mA	AC	630 A	1000 A	10000 A	10000 A
4116 67	80 A	400 V~	left	300 mA	AC	800 A	1000 A	10000 A	10000 A
LG1022	100 A	400 V~	left	300 mA	AC	1000 A	1000 A	10000 A	10000 A
LG3109	25 A	400 V~	left	500 mA	AC	500 A	1000 A	10000 A	10000 A
LG3110	40 A	400 V~	left	500 mA	AC	500 A	1000 A	10000 A	10000 A
LG3111	63 A	400 V~	left	500 mA	AC	630 A	1000 A	10000 A	10000 A
LG3112	80 A	400 V~	left	500 mA	AC	800 A	1000 A	10000 A	10000 A
LG3113	100 A	400 V~	left	500 mA	AC	1000 A	1000 A	10000 A	10000 A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE

www.lcie.fr

Date: 10/10/2022



LABORATOIRE CENTRAL DES
 INDUSTRIES ELECTRIQUES
 S.A.S au capital de 15.745.984 €
 RCS Nanterre B 408 363 174
 33 avenue du Général Leclerc
 F - 92266 FONTENAY AUX ROSES

Signature: **Julien GAUTHIER**
 Certification Officer


ANNEX (continued)

Reference DX ³ series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
4116 74	25 A	400 V~	left	30 mA	A	500 A	1000 A	10000 A	10000 A
4116 75	40 A	400 V~	left	30 mA	A	500 A	1000 A	10000 A	10000 A
4116 76	63 A	400 V~	left	30 mA	A	630 A	1000 A	10000 A	10000 A
4116 77	80 A	400 V~	left	30 mA	A	800 A	1000 A	10000 A	10000 A
4116 78	100 A	400 V~	left	30 mA	A	1000 A	1000 A	10000 A	10000 A
LG3129	25 A	400 V~	left	100 mA	A	500 A	1000 A	10000 A	10000 A
LG3130	40 A	400 V~	left	100 mA	A	500 A	1000 A	10000 A	10000 A
LG3131	63 A	400 V~	left	100 mA	A	630 A	1000 A	10000 A	10000 A
LG3132	80 A	400 V~	left	100 mA	A	800 A	1000 A	10000 A	10000 A
LG3133	100 A	400 V~	left	100 mA	A	1000 A	1000 A	10000 A	10000 A
								10000 A	10000 A
4116 84	25 A	400 V~	left	300 mA	A	500 A	1000 A	10000 A	10000 A
4116 85	40 A	400 V~	left	300 mA	A	500 A	1000 A	10000 A	10000 A
4116 86	63 A	400 V~	left	300 mA	A	630 A	1000 A	10000 A	10000 A
4116 87	80 A	400 V~	left	300 mA	A	800 A	1000 A	10000 A	10000 A
4116 88	100 A	400 V~	left	300 mA	A	1000 A	1000 A	10000 A	10000 A
LG3136	25 A	400 V~	left	500 mA	A	500 A	1000 A	10000 A	10000 A
LG3137	40 A	400 V~	left	500 mA	A	500 A	1000 A	10000 A	10000 A
LG3138	63 A	400 V~	left	500 mA	A	630 A	1000 A	10000 A	10000 A
LG3139	80 A	400 V~	left	500 mA	A	800 A	1000 A	10000 A	10000 A
LG3140	100 A	400 V~	left	500 mA	A	1000 A	1000 A	10000 A	10000 A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 10/10/2022

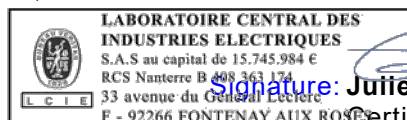

LABORATOIRE CENTRAL DES
 INDUSTRIES ELECTRIQUES
 S.A.S au capital de 15.745.984 €
 RCS Nanterre B 408 363 174
 33 avenue du Général Leclerc
 F - 92266 FONTENAY AUX ROSES
 Signature: Julien GAUTHIER
 Certification Officer

ANNEX (continued)

Reference DX ³ series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
LG3115	25 A	400 V~	left	100 mA	AC-S	500 A	1000 A	10000 A	10000 A
LG3116	40 A	400 V~	left	100 mA	AC-S	500 A	1000 A	10000 A	10000 A
LG3117	63 A	400 V~	left	100 mA	AC-S	630 A	1000 A	10000 A	10000 A
LG3118	80 A	400 V~	left	100 mA	AC-S	800 A	1000 A	10000 A	10000 A
LG3119	100 A	400 V~	left	100 mA	AC-S	1000 A	1000 A	10000 A	10000 A

LG1129	25 A	400 V~	left	300 mA	AC-S	500 A	1000 A	10000 A	10000 A
4116 68	40 A	400 V~	left	300 mA	AC-S	500 A	1000 A	10000 A	10000 A
4116 69	63 A	400 V~	left	300 mA	AC-S	630 A	1000 A	10000 A	10000 A
LG1130	80 A	400 V~	left	300 mA	AC-S	800 A	1000 A	10000 A	10000 A
LG1131	100 A	400 V~	left	300 mA	AC-S	1000 A	1000 A	10000 A	10000 A

LG3122	25 A	400 V~	left	500 mA	AC-S	500 A	1000 A	10000 A	10000 A
LG3123	40 A	400 V~	left	500 mA	AC-S	500 A	1000 A	10000 A	10000 A
LG3124	63 A	400 V~	left	500 mA	AC-S	630 A	1000 A	10000 A	10000 A
LG3125	80 A	400 V~	left	500 mA	AC-S	800 A	1000 A	10000 A	10000 A
LG3126	100 A	400 V~	left	500 mA	AC-S	1000 A	1000 A	10000 A	10000 A

Reference DX ³ series	In	Un	Neutral position	IΔn	Type	Im	IΔm	Inc	IΔc
LG3252	25 A	220/380 V~	left	30 mA	AC	500 A	1000 A	10000 A	10000 A
LG3253	40 A	220/380 V~	left	30 mA	AC	500 A	1000 A	10000 A	10000 A
LG3254	63 A	220/380 V~	left	30 mA	AC	630 A	1000 A	10000 A	10000 A
LG3255	80 A	220/380 V~	left	30 mA	AC	800 A	1000 A	10000 A	10000 A
LG3256	100 A	220/380 V~	left	30 mA	AC	1000 A	1000 A	10000 A	10000 A

LG3258	25 A	220/380 V~	left	300 mA	AC	500 A	1000 A	10000 A	10000 A
LG3259	40 A	220/380 V~	left	300 mA	AC	500 A	1000 A	10000 A	10000 A
LG3260	63 A	220/380 V~	left	300 mA	AC	630 A	1000 A	10000 A	10000 A
LG3261	80 A	220/380 V~	left	300 mA	AC	800 A	1000 A	10000 A	10000 A
LG3262	100 A	220/380 V~	left	300 mA	AC	1000 A	1000 A	10000 A	10000 A



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 10/10/2022



Signature: Julien GAUTHIER
 Certification Officer

ANNEX (continued)


Reference DX ³ series	In	Un	Neutral position	I Δ n	Type	I Δ m	I Δ m	I Δ c	I Δ c
4118 32	25 A	220/380 V~	left	30 mA	A	500 A	1000 A	10000 A	10000 A
4118 33	40 A	220/380 V~	left	30 mA	A	500 A	1000 A	10000 A	10000 A
4118 34	63 A	220/380 V~	left	30 mA	A	630 A	1000 A	10000 A	10000 A
4118 35	80 A	220/380 V~	left	30 mA	A	800 A	1000 A	10000 A	10000 A
4118 36	100 A	220/380 V~	left	30 mA	A	1000 A	1000 A	10000 A	10000 A
4118 37	25 A	220/380 V~	left	300 mA	A	500 A	1000 A	10000 A	10000 A
4118 38	40 A	220/380 V~	left	300 mA	A	500 A	1000 A	10000 A	10000 A
4118 39	63 A	220/380 V~	left	300 mA	A	630 A	1000 A	10000 A	10000 A
4118 40	80 A	220/380 V~	left	300 mA	A	800 A	1000 A	10000 A	10000 A
4118 41	100 A	220/380 V~	left	300 mA	A	1000 A	1000 A	10000 A	10000 A

These products are dedicated to Brazilian and Mexican market (voltage 220/380V).



LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 10/10/2022

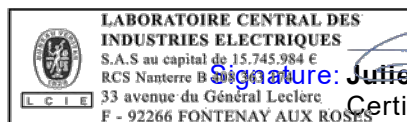

Signature: *Julien GAUTHIER*
 Certification Officer

ANNEX (end)

Independent of line voltage :	Oui / yes
rated frequency : (Hz)	50 Hz
delay time	without or with S
nature of supply :	~
total number of poles :	4
Rated insulation voltage U_i : (V)	500 V~
Rated impulse withstand voltage U_{imp} : (V)	4 000 V
Utilisation range temperature : (°C)	-25 °C à/to +40 °C
Rated residual making and breaking capacity $I_{\Delta m}$: (A)	1 000 A
Rated conditional short-circuit current I_{nc} : (A)	10 000 A
Rated conditional residual short-circuit current $I_{\Delta c}$: (A)	10 000 A
Short-circuit protection devices :	Fuse Gg of the same rated current
short-circuit tests :	35mm
Protection against external influences :	enclosed
Protection degree :	IP20
Material group :	II
Method of mounting :	panel board – on rail
Method of electrical connection :	
not associated with the mechanical-mounting	
Type of terminals :	pillar terminals
Nominal diameter of thread : (mm)	5
Operating means :	Lever




LABORATOIRE CENTRAL DES INDUSTRIES ELECTRIQUES - LCIE
 33 avenue du Général Leclerc
 92260 Fontenay-aux-Roses, FRANCE
www.lcie.fr

Date: 10/10/2022



LABORATOIRE CENTRAL DES
 INDUSTRIES ELECTRIQUES
 S.A.S au capital de 15.745.984 €
 RCS Nanterre B 408 363 174
 33 avenue du Général Leclerc
 F - 92266 FONTENAY AUX ROSES

Signature: 
 Julien GAUTHIER
 Certification Officer